



中国国家强制性产品认证证书

证书编号: 2016010307845775

委托人名称、地址

浙江正泰电器股份有限公司
浙江省乐清市北白象镇正泰工业园区正泰路1号

生产者(制造商)名称、地址

浙江正泰电器股份有限公司
浙江省乐清市北白象镇正泰工业园区正泰路1号

生产企业名称、地址

浙江正泰电器股份有限公司
浙江省温州经济开发区滨海二道1318号

产品名称和系列、规格、型号

塑料外壳式断路器

NXM-320S, NXM-320H, NXM-250S, NXM-250H, NXMS-320H, NXMS-320R, NXMS-250H, NMS-250R; 型号解释详见附件

产品标准和技术要求

GB/T 14048.2-2008

上述产品符合强制性产品认证实施规则

CNCA-C03-02: 2014的要求, 特发此证。

发证日期: 2017年05月26日

有效期至: 2021年02月28日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书, 证书首次颁发日期: 2016年02月29日

本证书的相关信息可通过国家认监委网站www.cnca.gov.cn查询



主任:



中国质量认证中心



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

No. : 2016010307845775

NAME AND ADDRESS OF THE APPLICANT

Zhejiang CHINT Electrics Co., Ltd.
No.1, CHINT Road, CHINT Industrial Zone, North Baixiang Town, Yueqing
City, Zhejiang Province, P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

Zhejiang CHINT Electrics Co., Ltd.
No.1, CHINT Road, CHINT Industrial Zone, North Baixiang Town, Yueqing
City, Zhejiang Province, P.R.China

NAME AND ADDRESS OF THE FACTORY

Zhejiang CHINT Electrics Co., Ltd.
No.1318, Binhai No.2 Avenue, Economic and Technical Development Zone,
Wenzhou City, Zhejiang Province, P.R. China

NAME, MODEL AND SPECIFICATION

Moulded Case Circuit Breaker

NXM-320S, NXM-320H, NXM-250S, NXM-250H, NXMS-320H, NXMS-320R, NXMS-250H, NMS-250R;

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 14048.2-2008

This is to certify that the above mentioned products have met the requirements of implementation rules for compulsory certification(REF NO. CNCA-C03-02:2014).

Date of issue: May.26, 2017 Date of expiry: Feb.28, 2021

Validity of this certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Date of original certification: Feb.29, 2016

This certificate can be verified through CNCA's website: www.cnca.gov.cn



President:

Wang Kejiao



CHINA QUALITY CERTIFICATION CENTRE



中国国家强制性产品认证证书

附录:

第 1 页 共 5 页

证书编号: 2016010307845775

纸号: 1706322

NXM-320S、NXM-320H、NXM-250S、NXM-250H、NXMS-320H、NXMS-320R、NXMS-250H、NMS-250R

Ui:800V;Uimp:8kV;

Ue: AC400/415V,AC690V (2P 不适用);

NXM-250S、NXM-250H: In: 125A, 140A,150A,160A,170A,180 A, 200A, 225A, 250A;

NXM-320S、NXM-320H: In: 125A, 140A,150A,160A,170A,180A, 200A,225A,250A,270A,280 A,300A, 315A,320A;

NXMS-250H/R: In: 250A;

NXMS-320H/R: In: 320A;

过电流脱扣器类型: 热磁式、电磁式、电子式;

额定运行短路分断能力 Ics:

AC400/415V: 20kA(S 型), 35kA(H 型), 50kA(R 型),

AC690V: 5kA(S 型), 5kA(H 型); 5kA(R 型)

额定极限短路分断能力 Icu:

AC400/415V: 35kA(S 型), 50kA(H 型),50kA(R 型),

AC690V: 8kA(S 型), 10kA(H 型), 10kA(R 型)

使用类别: A;

极数: 2P(仅热磁式),3P,3P+N(3 个保护极,N 极常通, 仅热磁式),4P;

其中 3P+N 不适用于隔离

适用频率: 50/60Hz

配用的辅助触头:

Ith:3A;

AC-15: Ue/Ie: AC415/400/380V/0.26A;

DC-13: Ue/Ie: DC250/DC220/110V/0.14A;

符合附录 N 的电子附件:

注: 此附录与证书同时使用时有效。



主任:



中国质量认证中心



中国国家强制性产品认证证书

附录:

第 2 页 共 5 页

证书编号: 2016010307845775

纸号: 1706322

与预付费产品配用的分励脱扣器: SHT: AC220V/230V/240V, AC380V/400V/415V

欠压脱扣器: UVT: AC220V/230V/240V, AC380V/400V/415V;

电动操作机构: MD: AC220V/230V/240V, DC110V/220V/250V, AC380V/400V/415V

注: 此附录与证书同时使用时有效。



主 任:



中国质量认证中心



中国国家强制性产品认证证书


附录:

第 3 页 共 5 页

证书编号: 2016010307845775

纸号: 1706322

型号的解释:

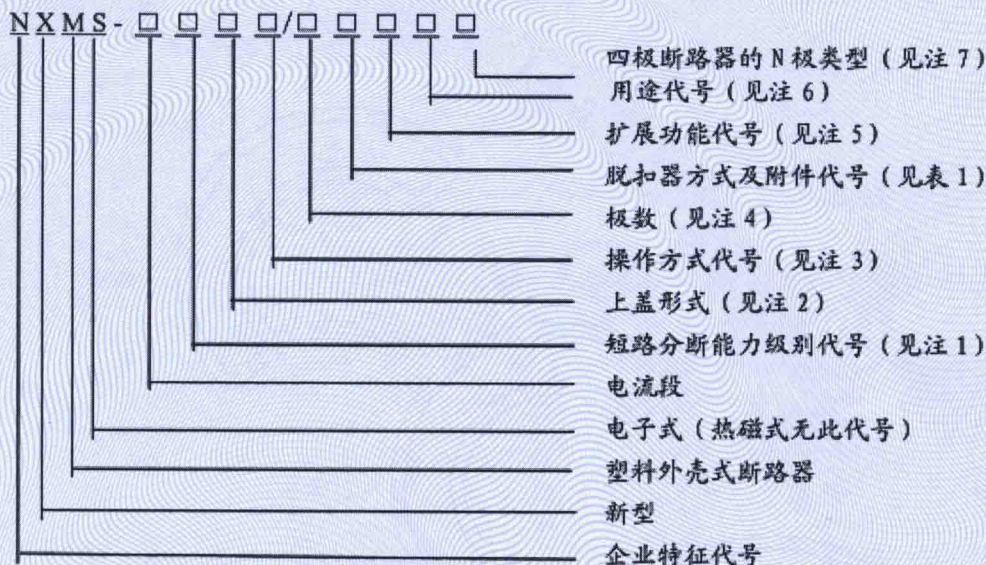

注:

1. 短路分断能力级别: 标准型 (代号 S, 电子式无此型号), 较高型 (代号 H), 高性能型 (代号 R);
2. 双层盖 (无代号)
3. 按操作方式分: 手柄直接操作 (无代号); 电动操作用 P 表示; 转动手柄操作用 Z 表示;
4. 按极数分: 二极 (代号 2); 三极 (代号 3); 四极 (代号 4)
5. 按扩展功能分: 热保护可调 (代号 T); 热保护和磁保护均不可调 (无代号); 过载报警不脱扣 (代号 G)
6. 按用途分: 配电保护用 (无代号); 电动机保护用 (代号 2)
7. 四极产品中性极 (N) 的型式分为 4 种:
 - A 型: N 极不安装过电流脱扣元件, 且 N 极始终接通, 不与其它三极一起合分;
 - B 型: N 极不安装过电流脱扣元件, 且 N 极与其它三极一起合分 (N 极先合后分);
 - C 型: N 极安装过电流脱扣元件, 且 N 极与其它三极一起合分 (N 极先合后分);
 - D 型: N 极不安装过电流脱扣元件, 且 N 极始终接通, 不与其它三极一起合分;

注: 此附录与证书同时使用时有效。



主任:



中国质量认证中心



中国国家强制性产品认证证书

附录:

第 4 页 共 5 页

证书编号: 2016010307845775

纸号: 1706322

附表 1 脱扣器方式及附件代号

附件名称	脱扣器型式及附件代号	
	电磁式脱扣器	热磁式/电子式脱扣器
无附件	200	300
报警触头	208	308
分励脱扣器	210 (210Y)	310(310Y)
辅助触头	220	320
欠压脱扣器	230	330
分励脱扣器、辅助触头	240 (240Y)	340 (340Y)
分励脱扣器、欠压脱扣器	250 (250Y)	350 (350Y)
二组辅助触头	260	360
辅助触头、欠压脱扣器	270	370
分励脱扣器、报警触头	218 (218Y)	318 (318Y)
辅助触头、报警触头	228	328
欠压脱扣器、报警触头	238	338
分励脱扣器、辅助触头、报警触头	248 (248Y)	348 (348Y)
二组辅助触头、报警触头	268	368

注: 此附录与证书同时使用时有效。



主 任:



中国质量认证中心



中国国家强制性产品认证证书

附录:

第 5 页 共 5 页

证书编号: 2016010307845775

纸号: 1706322

辅助触头、欠压脱扣器、报警触头	278	378
-----------------	-----	-----

注: 200 表示电磁式脱扣断路器 (仅有电磁脱扣器的断路器本体);
300 表示热磁脱式/电子式扣器本体;
括号内带 Y 的代号 (如 210Y) 表示预付费电表专用分励脱扣器, 动作延时时间 1s~2s, 控制电源电压 U_s : AC220V/AC230V/AC240V, AC380V/AC400V/AC415V

注: 此附录与证书同时使用时有效。



主 任:



中国质量认证中心