



中国国家强制性产品认证证书

证书编号: 2016010307852659

委托人名称、地址

浙江正泰电器股份有限公司
浙江省乐清市北白象镇正泰工业园区正泰路1号

生产者(制造商)名称、地址

浙江正泰电器股份有限公司
浙江省乐清市北白象镇正泰工业园区正泰路1号

生产企业名称、地址

浙江正泰电器股份有限公司
浙江省温州经济开发区滨海二道1318号

产品名称和系列、规格、型号

剩余电流动作断路器
NXMLE-320S、NXMLE-320H、NXMLE-250S、NXMLE-250H; 型号解释详见附件

产品标准和技术要求

GB/T14048.2-2008

上述产品符合强制性产品认证实施规则 CNCA-C03-02:2014 的要求,
特发此证。

发证日期: 2018年04月16日 有效期至: 2021年04月07日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书, 证书首次颁发日期: 2016年04月07日

本证书的相关信息可通过国家认监委网站 www.cnca.gov.cn 查询



主任:



中国质量认证中心



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO.: 2016010307852659

NAME AND ADDRESS OF THE APPLICANT

Zhejiang CHINT Electric Co., Ltd.
No.1 CHINT Road, CHINT Industrial Zone, North Baixiang Town, Yueqing City, Zhejiang
Province, P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

Zhejiang CHINT Electric Co., Ltd.
No.1 CHINT Road, CHINT Industrial Zone, North Baixiang Town, Yueqing City, Zhejiang
Province, P.R.China

NAME AND ADDRESS OF THE FACTORY

Zhejiang CHINT Electric Co., Ltd.
No.1318, Binhai No.2 Avenue, Economic and Technical Development Zone, Wenzhou City,
Zhejiang Province, P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION

Residual Current Operated Circuit Breaker
NXMLE-320S、NXMLE-320H、NXMLE-250S、NXMLE-250H; See the appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T14048.2-2008

This is to certify that the above mentioned product(s) complies with the requirements of
implementation rules for compulsory certification(REFNO.CNCA-C03-02:2014).

Valid from: Apr.16,2018

Valid until: Apr.07,2021

The validity of the certificate is subject to positive result of the regular follow up
inspection by issuing certification body until the expiry date.

Date of original issued: Apr.07,2016

The certificate information is available through CNCA's website: www.cnca.gov.cn



President:

Wang Kejiao



CHINA QUALITY CERTIFICATION CENTRE



中国国家强制性产品认证证书

附 录

第 1 页 共 4 页

证书编号: 2016010307852659

纸 号: 1922973

NXMLe-320S、NXMLE-320H、NXMLE-250S、NXMLE-250H

U_{imp} : 8kV; U_i : 800V;

U_e : AC230V/AC240V (2P, 1P+N); AC380V/AC400V/AC415V (3P, 3P+N, 4P);

NXMLe-250S、NXMLE-250H:

I_n : 125A, 140A, 150A, 160A, 170A, 180A, 200A, 225A, 250A;

NXMLe-320S、NXMLE-320H:

I_n : 125A, 140A, 150A, 160A, 170A, 180A, 200A, 225A, 250A, 270A, 280A, 300A, 315A, 320A;

过电流脱扣器类型: 热磁式, 电磁式;

S 型: I_{cu} =35kA, I_{cs} =18kA; H 型: I_{cu} =50kA, I_{cs} =25kA;

额定剩余动作电流 ($I_{\Delta n}$):

三档可调/单档/非延时型: (30/50/100/200/300/400/500/600/800/1000) mA;

三档可调/单档/延时型: (50/100/200/300/400/500/600/800/1000) mA;

额定剩余动作类型: AC 型, A 型;

漏电脱扣器的类型: 电子式;

剩余接通和分断能力 ($I_{\Delta m}$): S 型: 9kA; H 型: 12.5kA;

适用频率: 50Hz/60Hz; 使用类别: A;

极数: 2P, 1P+N (1 个保护极, N 极常通), 3P, 3P+N (3 个保护极, N 极常通), 4P
(3 个保护极, N 极可开闭);

适用于隔离 (1P+N、3P+N 除外);

配用的辅助触头: AX-M;

1NO1NC; I_{th} : 3A;

AC-15: U_e : AC380V/AC400V/AC415V, I_e : 0.26A;

DC-13: U_e : DC110V, DC220V/DC250V, I_e : 0.14A;

符合附录 N 的电子附件:

欠压脱扣器: AC220V/AC230V/AC240V, AC380V/AC400V/AC415V;

注: 此附录与证书同时使用时有效。



主 任:



中国质量认证中心



中国国家强制性产品认证证书

附 录

证书编号: 2016010307852659

第 2 页 共 4 页

纸 号: 1922973

电 动 操 作 机 构 : AC220V/AC230V/AC240V, DC110V , DC220V/DC250V ,
AC380V/AC400V/AC415V

型号解释:

注: 此附录与证书同时使用时有效。



主 任 :



中国质量认证中心




中国国家强制性产品认证证书

附 录

第 3 页 共 4 页

证书编号: 2016010307852659

纸 号: 1922973

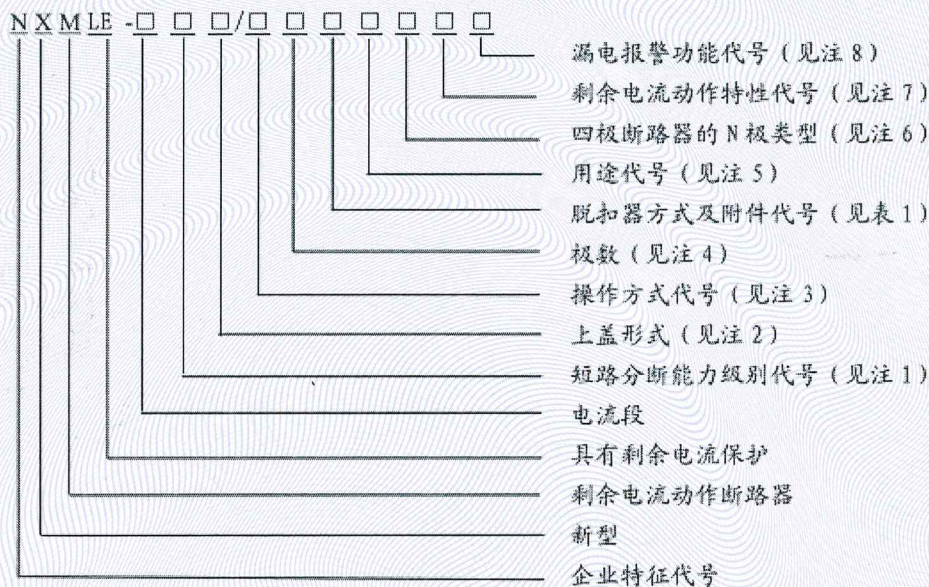

注:

1. 短路分断能力代号: 标准型 (代号 S), 较高型 (代号 H);
2. 上盖形式代号: 双层盖 (无代号);
3. 操作方式代号: 手柄直接操作 (无代号); 电动操作用 P 表示; 转动手柄操作用 Z 表示;
4. 极数代号: 二极 (代号 2); 三极 (代号 3); 四极 (代号 4)
5. 用途代号: 配电保护用 (无代号); 电动机保护用 (代号 2)
6. 四极产品中性极 (N) 的型式分为 2 种:
A 型: N 极不安装过电流脱扣元件, 且 N 极始终接通, 不与其他三极一起合分;
B 型: N 极不安装过电流脱扣元件, 且 N 极与其他三极一起合分 (N 极先合后分);
7. 剩余电流动作特性代号: 非延时型 (无代号); 延时型 (代号 Y);
8. 漏电报警功能代号: 不带剩余电流报警模块 (无代号); 带剩余电流报警模块 (代号 J), 漏电起停功能 (代号 Q)


注: 此附录与证书同时使用时有效。



主 任:



中国质量认证中心



中国国家强制性产品认证证书

附 录

证书编号: 2016010307852659

第 4 页 共 4 页

纸 号: 1922973

附表 1 脱扣器方式及附件代号

附件名称	脱扣器型式及附件代号	
	电磁式脱扣器	热磁脱扣器
无附件	200	300
报警触头	208	308
分励脱扣器	210	310
辅助触头	220	320
欠压脱扣器	230	330
分励脱扣器、辅助触头	240	340
二组辅助触头	260	360
辅助触头、欠压脱扣器	270	370
辅助触头、报警触头	228	328
二组辅助触头、报警触头	268	368

注: 200 表示电磁式脱扣断路器 (仅有电磁脱扣器的断路器本体);
300 表示热磁脱扣器本体;
000 表示无过电流保护要求的断路器 (不带脱扣器及内部附件的断路器本体)。

注: 此附录与证书同时使用时有效。



主 任:



中国质量认证中心